



GENERATOR

PERMIT APPLICATION

CITY OF WINTER SPRINGS
BUILDING AND PERMITTING
1126 E. SR 434
WINTER SPRINGS, FL. 32708
PHONE : 407-327-5963
FAX : 407-327-4784

Permit Number:

Parcel ID#:

City Of Winter Springs
Inspection Line
407-327-7596
Online Inspection Request
www.winterspringsfl.org/inspections

Owner's Name:

Phone:

Project Address:

Company Name:

Phone:

Mailing Address:

Phone:

Fax:

Use: Commercial Residential

Email:

Fuel Source: LPG Natural Gas Deisel Fuel

Generator Location:

Estimated Improvement Value:

Electrical Auto-Switch Relay Box Installed: Yes No

Mount Type: Fixed Portable

X

Owner /Agent Signature

STATE OF FLORIDA, COUNTY OF SEMINOLE
The foregoing instrument was acknowledged

Before me this _____ day of _____

20____ By _____

who is personally known to me/or has produced

_____ as identification and who (did not) take an oath.

Notary _____
(seal)

X

Contractor Signature

STATE OF FLORIDA, COUNTY OF SEMINOLE

The foregoing instrument was acknowledged

Before me this _____ day of _____

20____ By _____

who is personally known to me/or has produced

_____ as identification and who (did not) take an oath.


Notary _____
(seal)

The applicant agrees to comply with the Municipal Ordinances and with the conditions of this permit; understands that the issuance of this permit creates no legal liability; express or implied, of the Department, municipality, Agency or Inspector; and certifies that all of the above information is accurate.

PERMIT EXPIRATION:Permit expires 180 days from date issued unless otherwise noted below or governed by law.

WARNING TO OWNER:YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE COMMENCING WORK OR RECORDING YOUR NOTICE OF COMMENCEMENT.

... AND LIQUID CONTAINERS. (This figure for illustrative purposes only; code shall govern.)

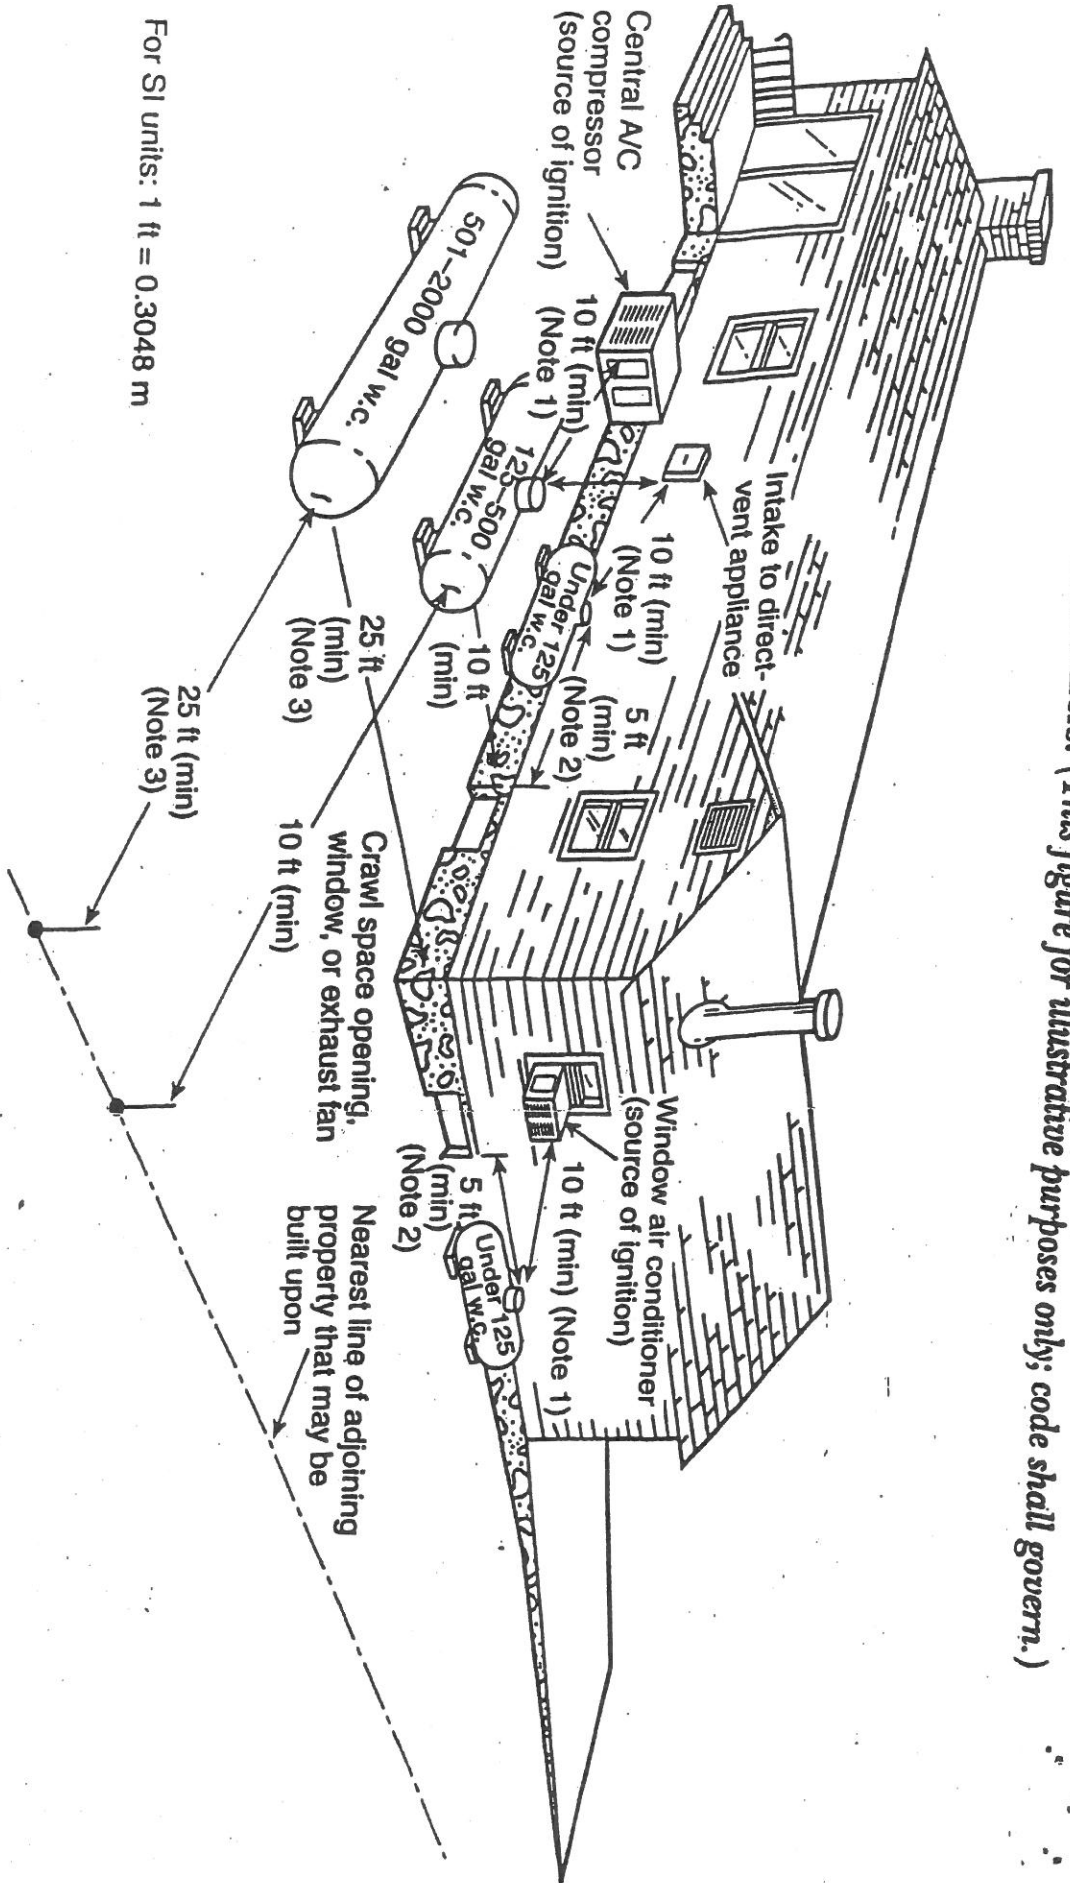

For SI units: 1 ft = 0.3048 m

Note 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system. Refer to 3.2.2.2(d).

Note 2: Refer to 3.2.2.2(c)

Note 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m³) water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m³) water capacity. Refer to 3.2.2.2(e).